


REFER TO HYDROTECH'S GUIDELINE ROOFING & WATERPROOFING DETAILS FOR FLASHING TERMINATIONS.



NOTES:

- ROOT STOP IS LOOSE-LAID OVER THE HYDROFLEX 30 AND LAPPED A MINIMUM OF 1500 mm OR 760 mm WITH LAPS TAPED USING ROOT STOP TAPE.
- IF INSULATION IS NOT INSTALLED, THE HYDRODRAIN AIR LAYER MAY BE OMITTED.
- HYDRODRAIN 300 IS REQUIRED WHENEVER MOISTURE RETENTION MAT IS TO BE INSTALLED OVER THE INSULATION. DO NOT TURN UP AT VERTICAL SURFACES.
- THE VEGETATION FREE ZONE (VFZ) MAY BE COMPOSED OF TYPICAL STONE BALLAST OR CONCRETE PAVERS. CONTACT HYDROTECH FOR BALLAST DESIGN REQUIREMENTS. VFZs ARE REQUIRED AT ALL ROOF PERIMETERS AND ALL PENETRATIONS (PIPES, SKYLIGHTS, ETC.). GARDENEDGE METAL EDGE RESTRAINT, CONCRETE CURBS, LANDSCAPE TIMBERS, ETC. MAY BE USED AT VFZ/GROWING MEDIA TRANSITIONS IN ORDER TO HAVE A TRANSITION PROVIDING DRAINAGE OF WATER.
- CONTACT HYDROTECH FOR VEGETATION FREE ZONE WIDTH AND MATERIAL REQUIREMENTS FOR WIND WARRANTY.
- VERIFY THE REQUIREMENTS OF LOCAL ORGANIZATIONS FOR VEGETATION FREE ZONE DESIGN REQUIREMENTS.

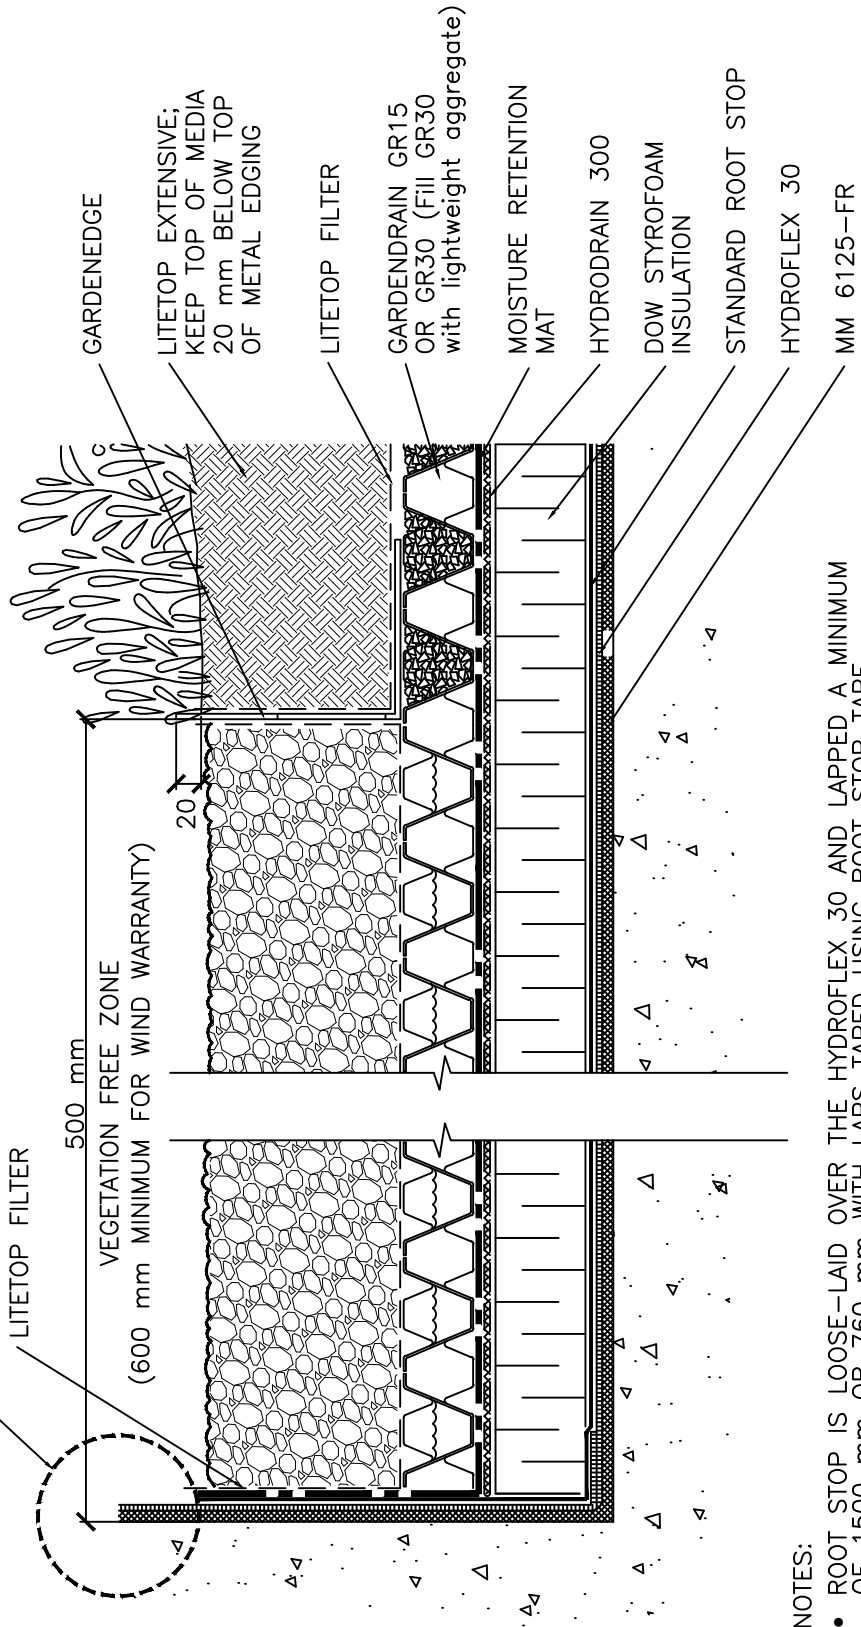

GARDEN  
ROOF  
ASSEMBLY

EXTENSIVE GARDENROOF  
TERMINATION DETAIL  
(MAXIMUM WATER RETENTION)

HYDROTECH MEMBRANE CORP.

NO SCALE

GAC-2B