determination of the suitability and applicability of this information is the sole responsibility of the

GARDEN
HYDROTECH ROOF
ASSEMBLY

AME

RIC


D

ROTECH,

SCALE: NONE

GN-5F

TYPICAL TOP OF SLOPE STACKED GARDNET CONNECTION WITH STANCHION POST

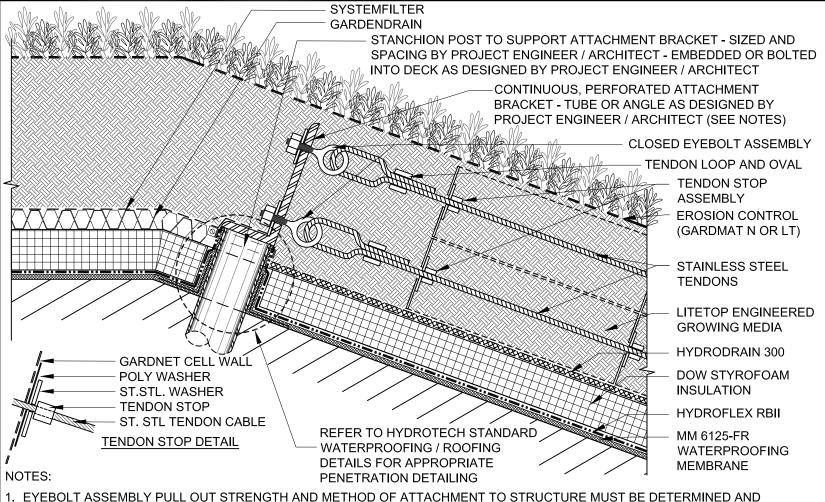

- EYEBOLT ASSEMBLY PULL OUT STRENGTH AND METHOD OF ATTACHMENT TO STRUCTURE MUST BE DETERMINED AND VERIFIED BY PROJECT ENGINEER.
- PRIOR TO SHIPPING GARDNET MATERIALS, PROJECT ARCHITECT / ENGINEER MUST PROVIDE HYDROTECH A SIGNED AND SEALED CONSTRUCTION DETAIL INDICATING GARDNET ATTACHMENT TO BUILDING STRUCTURE.
- 3. IF DOW STYROFOAM INSULATION IS NOT INSTALLED, HYDRODRAIN 302 SHALL BE PLACED ON TOP OF THE HYDROFLEX RB II.
- 4. NUMBER OF STOPS AND NUMBER AND LENGTH OF REQUIRED TENDONS IS DETERMINED BY MEDIA DEPTH AND DEGREE & LENGTH OF SLOPE.
- 5. LITETOP GROWING MEDIA IS REQUIRED FOR ALL GARDNET INSTALLATIONS. NO SUBSTITUTIONS ARE ALLOWED.
- 6. UPPER LAYER OF GARDNET CELLS MUST BE OVERFILLED WITH LITETOP MEDIA BY 1/2"-1".
- 7. GARDMAT EROSION MAT SHALL BE INSTALLED WHEN PLANTING PLUGS. NO GARDMAT IS REQUIRED WHEN INSTALLING INSTAGREEN SEDUM CARPET OR TILE.